





MSP-AS

MSP-AS_rev01

Short-Circuit Signaller

When shortcircuit (and not overload) occurs, alarm contact 1NO+1NC changes over which can be used to give indication.

Configuration: 1NO+1NC (AC-15: 3A/230V, 1.5A/400V, 1A/500V)

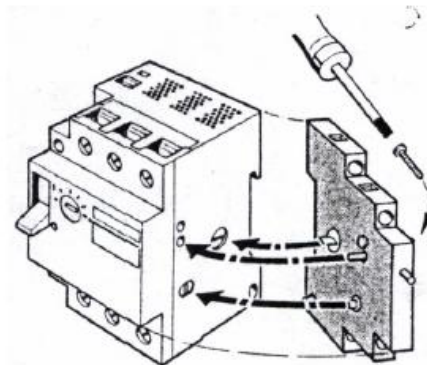

SYMBOL: 1NO+1NC



ETI Elektroelement d.o.o.
1411 Izlake
Obrezija 5
Slovenia
Phone: +386(0)356 57 570
Fax: +386(0)356 74 077
www.etigroup.eu